




AFTER CONDUITS AND CONDUCTORS ARE INSTALLED FILL IN VOID WITH SAND OR PEA GRAVEL AND GROUT LAST 20mm

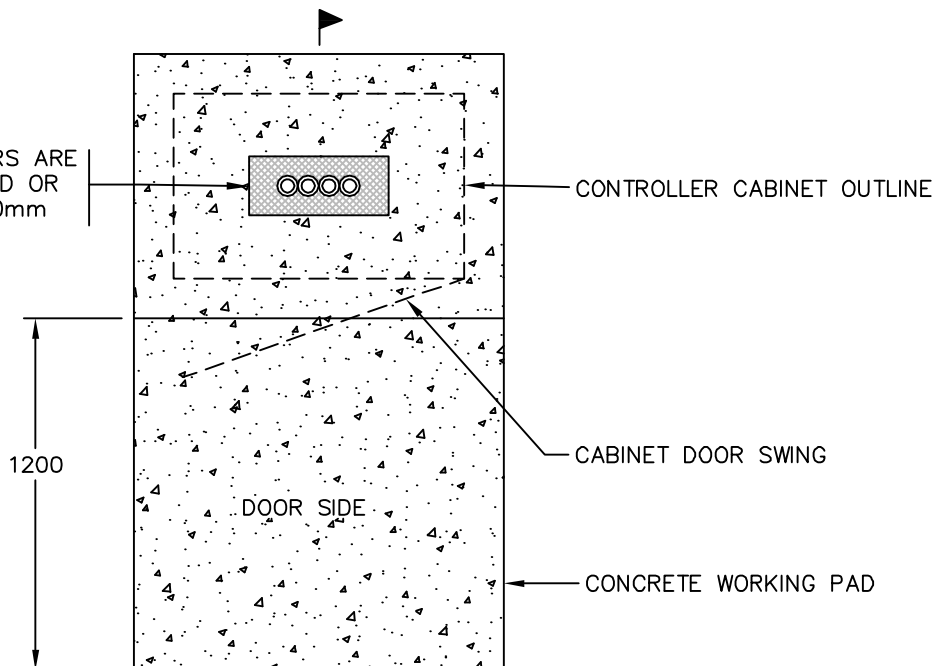

TOP VIEW

STRIP JACKET OFF SIGNAL CABLES 100mm ABOVE CONCRETE. NEATLY ARRANGE AND BUNDLE.

SEAL ALL AROUND CONTROLLER CABINET AND CONCRETE BASE WITH SILICONE SEALANT

LABEL SIGNAL CABLE WITH IT'S CORRECT PHASING COLOR (ie.  $\phi 2$  RED,  $\phi 4$  BLUE,  $\phi 6$  YELLOW,  $\phi 8$  GREEN)

R.PVC CONDUIT (SIZE AND NUMBER VARIES)

FACTORY CONDUIT BEND

SECTION (A)

ALL CONDUITS TO BE FLUSH TO CONCRETE

DOOR

FINISHED GRADE

300

100

R.PVC COUPLING (TYPICAL)

NOTES:

1. REFER TO CONTRACT DRAWING SECTION 34 41 13 FOR DETAILED SPECIFICATIONS.
2. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE NOTED.
3. MAINTAIN SHEILDING ON LOOP CABLES TO TERMINALS. CONNECT DRAIN WIRE AT TERMINALS.

NO.	DATE	REVISION	DESCRIPTION	BY	APP

**CONTROLLER INSTALLATION  
(FOR TYPE P AND M  
CABINETS)**

**CITY OF KAMLOOPS**

DWN. BY: DAR      CHK'D BY: P.Pouliotte

SCALE: N.T.S.

DATE: 11/02/21

DWG. NO.: **SE1.4**

REV.: