


MINIMUM 2000 FROM EDGE ASPHALT
(IN CUL-DE-SAC)

600 FROM
PROPERTY LINE
(IN BOULEVARD)

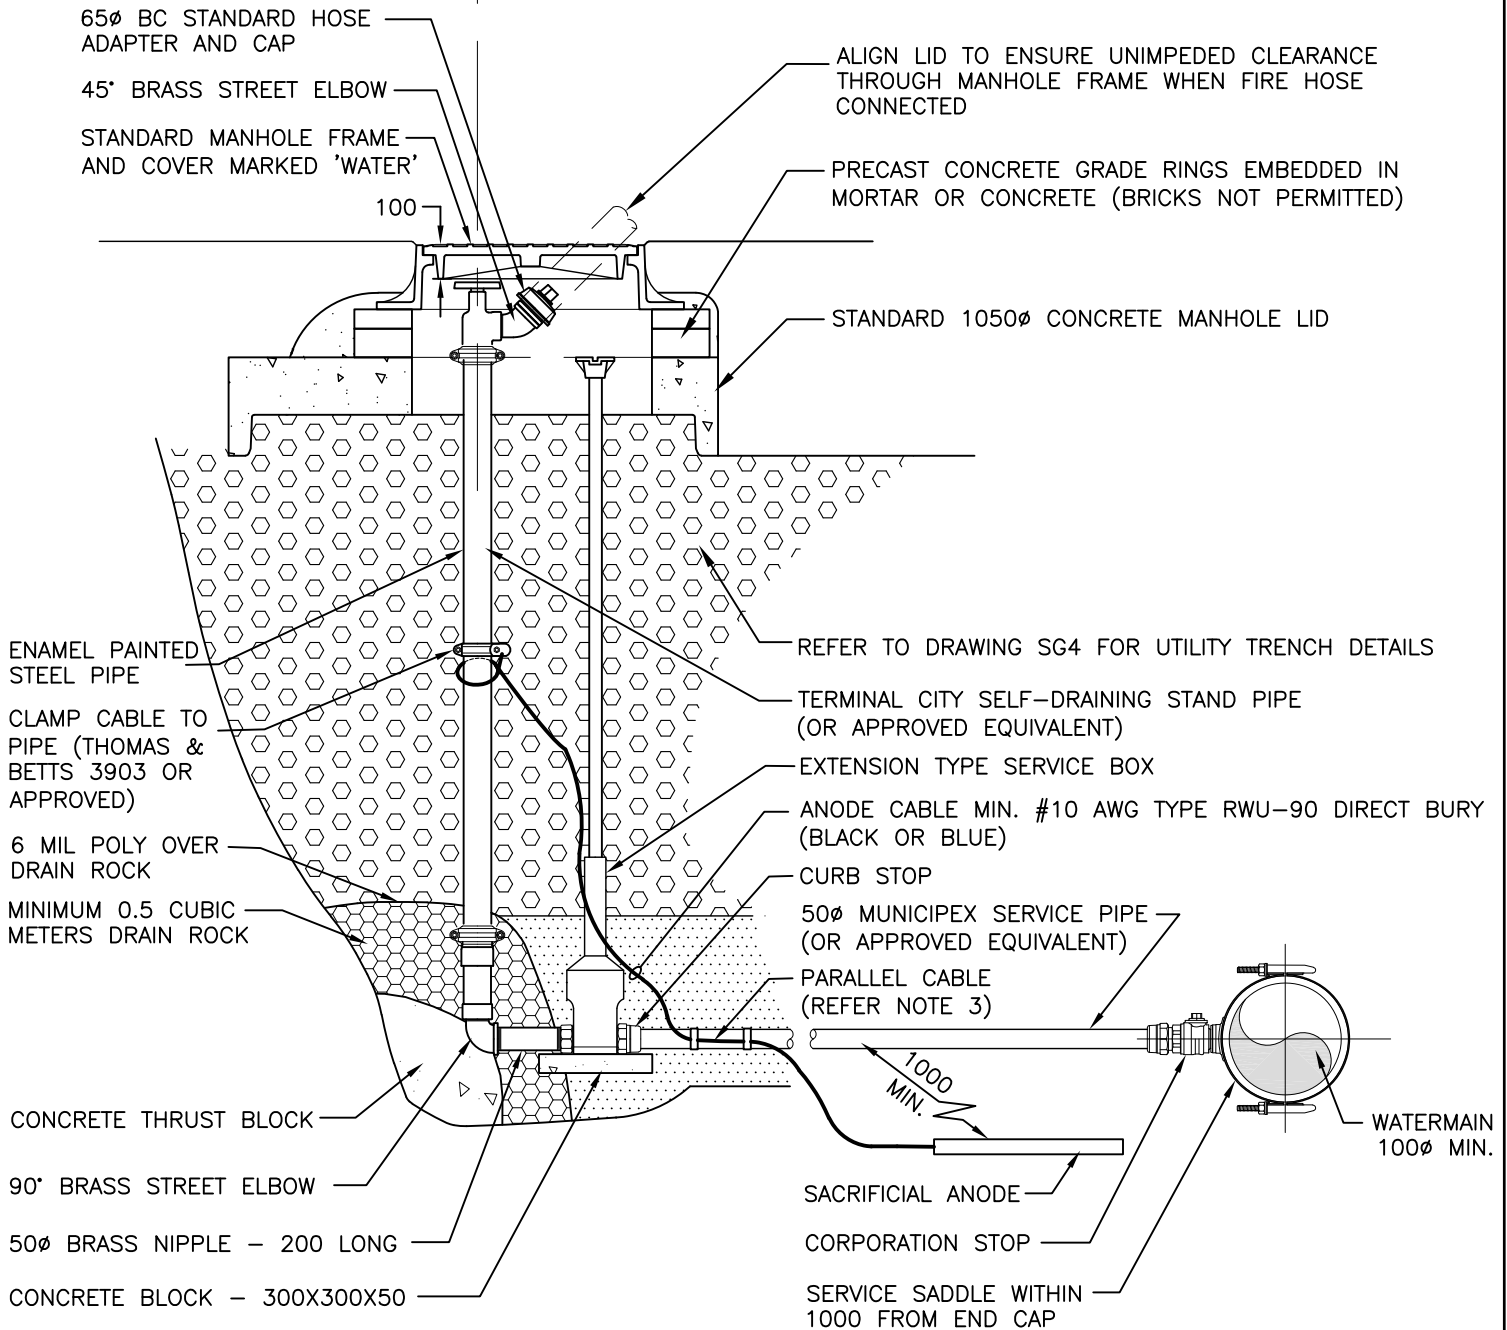

NOTE: 1. REFER TO CONTRACT DRAWINGS AND SECTIONS 33 11 01 AND 33 44 01 FOR DETAILED SPECIFICATIONS.
2. CORROSION PROTECTION INFRASTRUCTURE IS TO BE INSTALLED UNLESS TESTING OR CONTRACT DRAWINGS INDICATES OTHERWISE.
3. ALL CABLES PARALLEL TO PIPE TO BE ATTACHED TO PIPE USING PIPE TAPE.

NOT TO SCALE

SELF-DRAINING STANDPIPE (BURIED) & CORROSION PROTECTION



No.	DATE	REVISION DESCRIPTION	BY	APP
7	APR2022	REVIEWED AND UPDATED 2022	IP	JDh
6	MAY2019	REVIEWED AND ADDED CATHODIC	DAR	JDh
5	JAN2019	REVIEWED AND UPDATED 2019	DAR	JDh

REV. 7
 DWG. No. SW8